
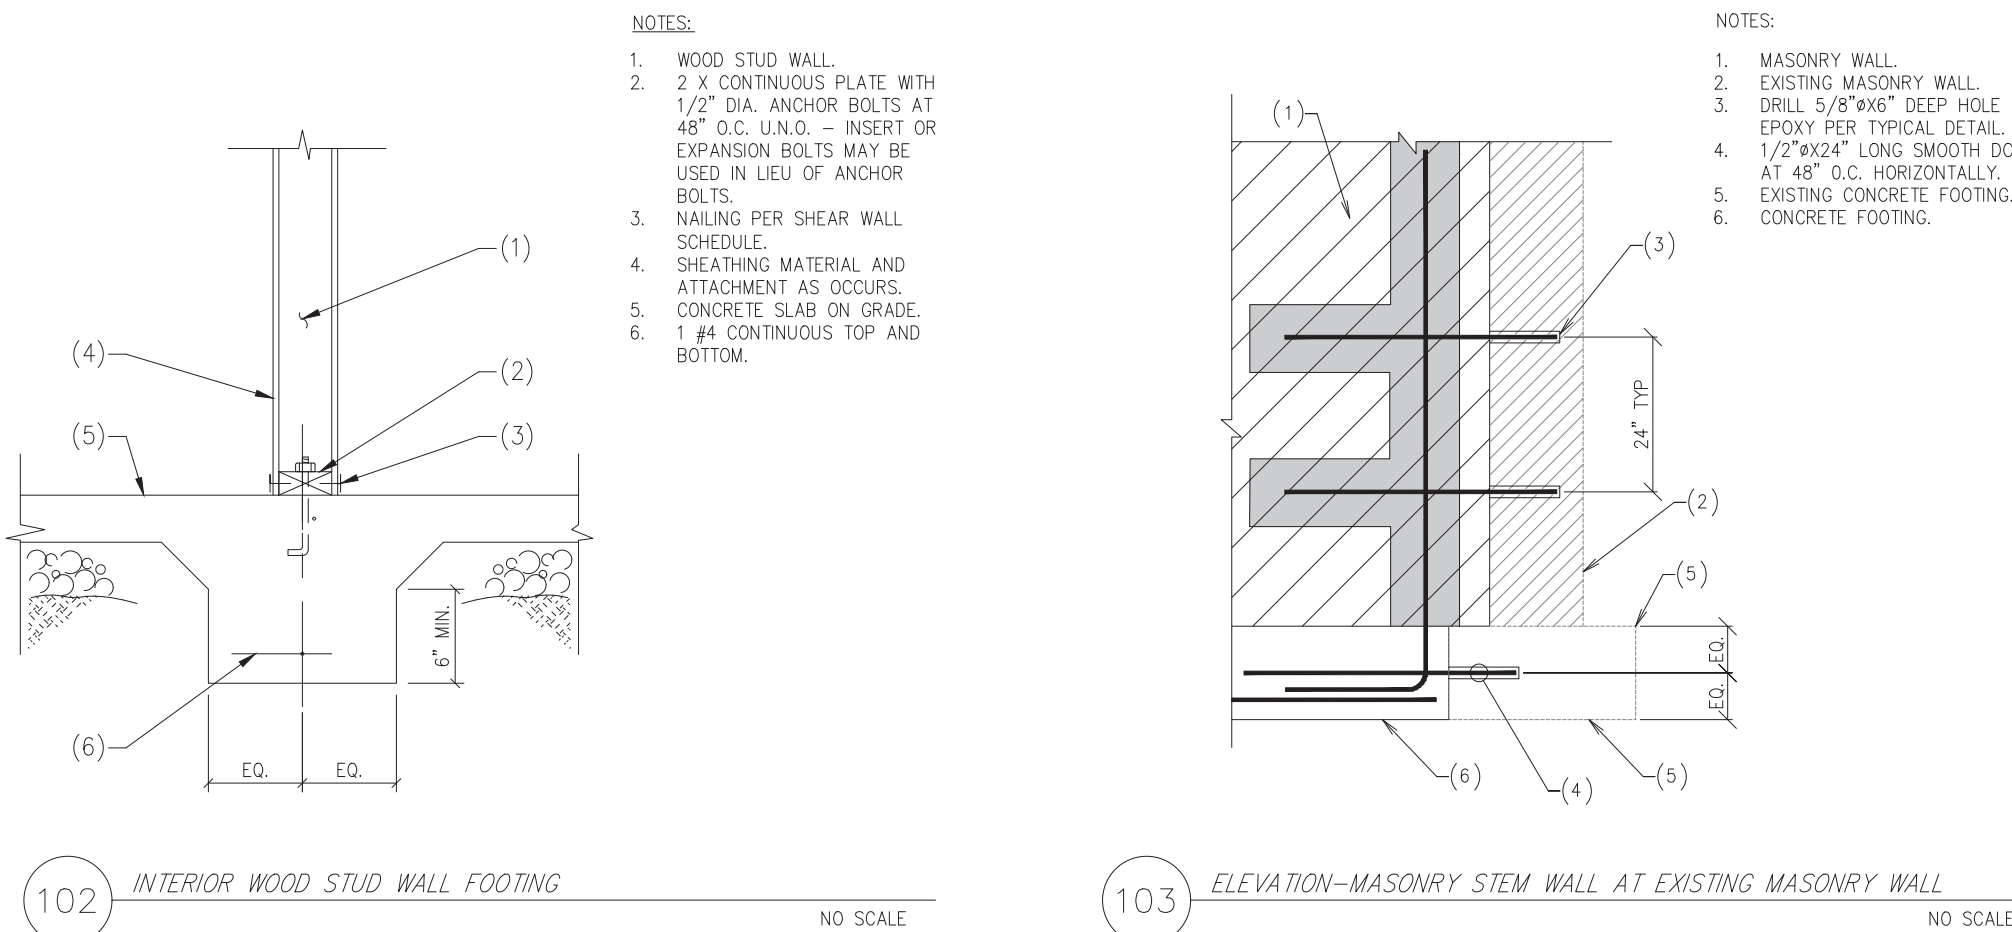
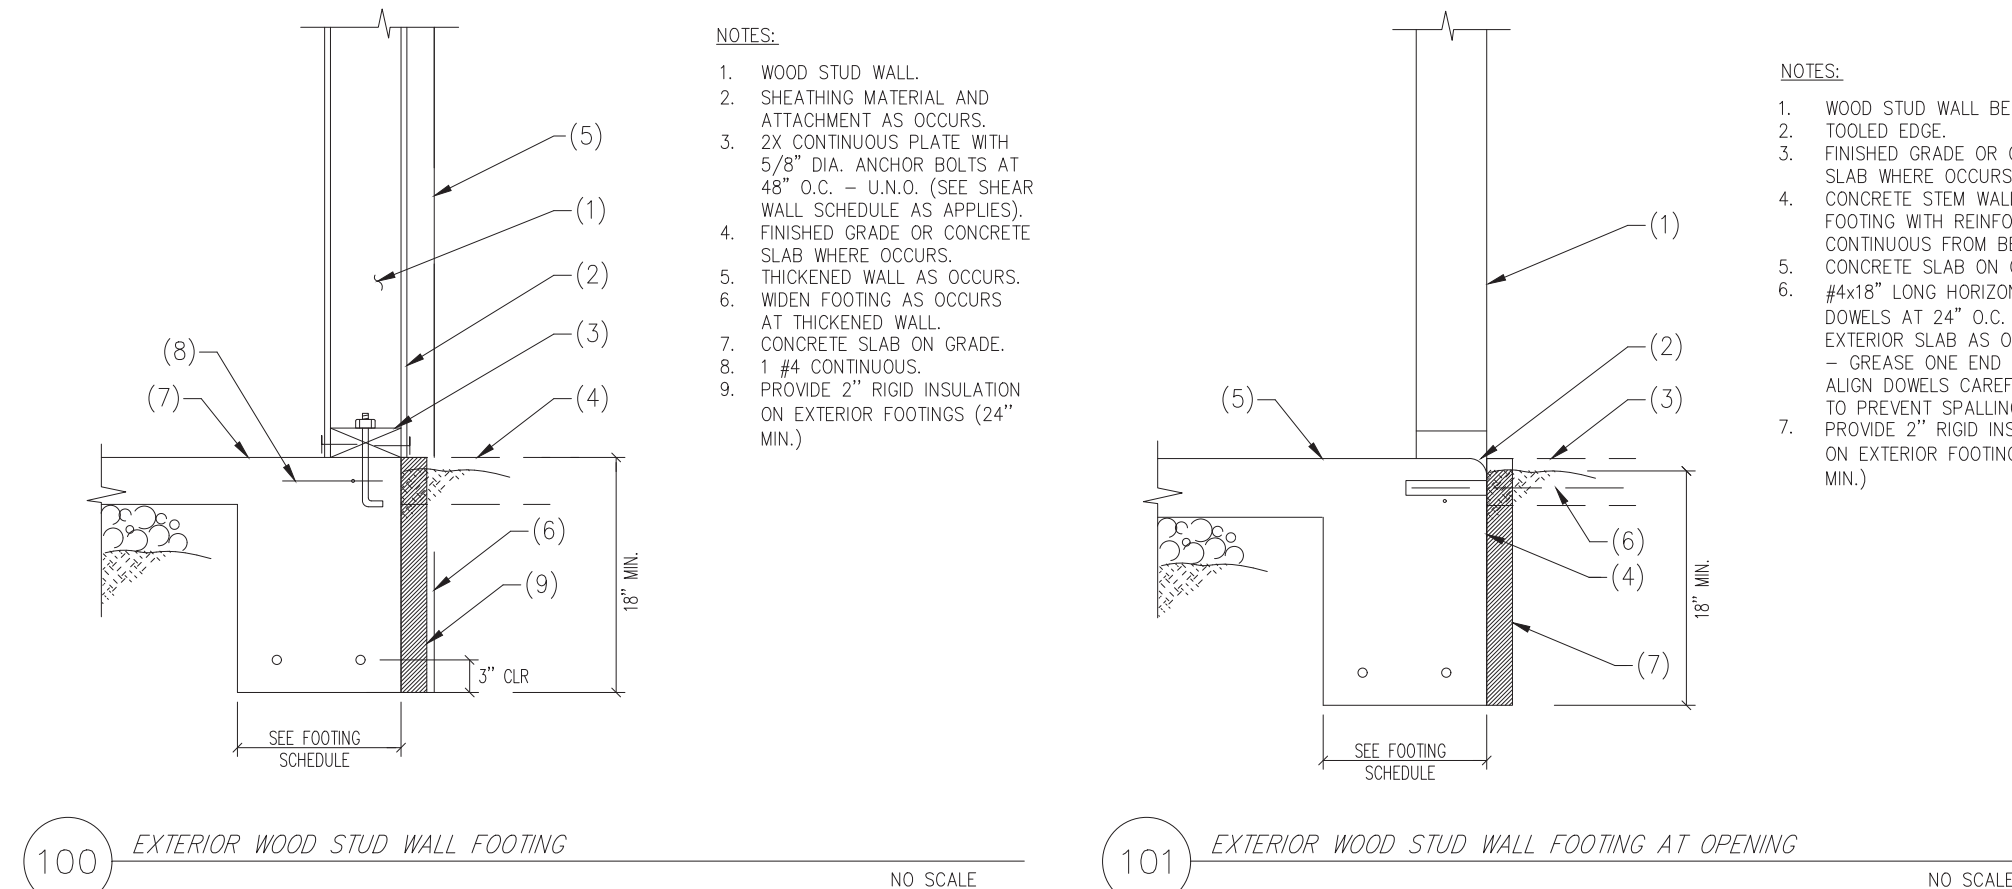
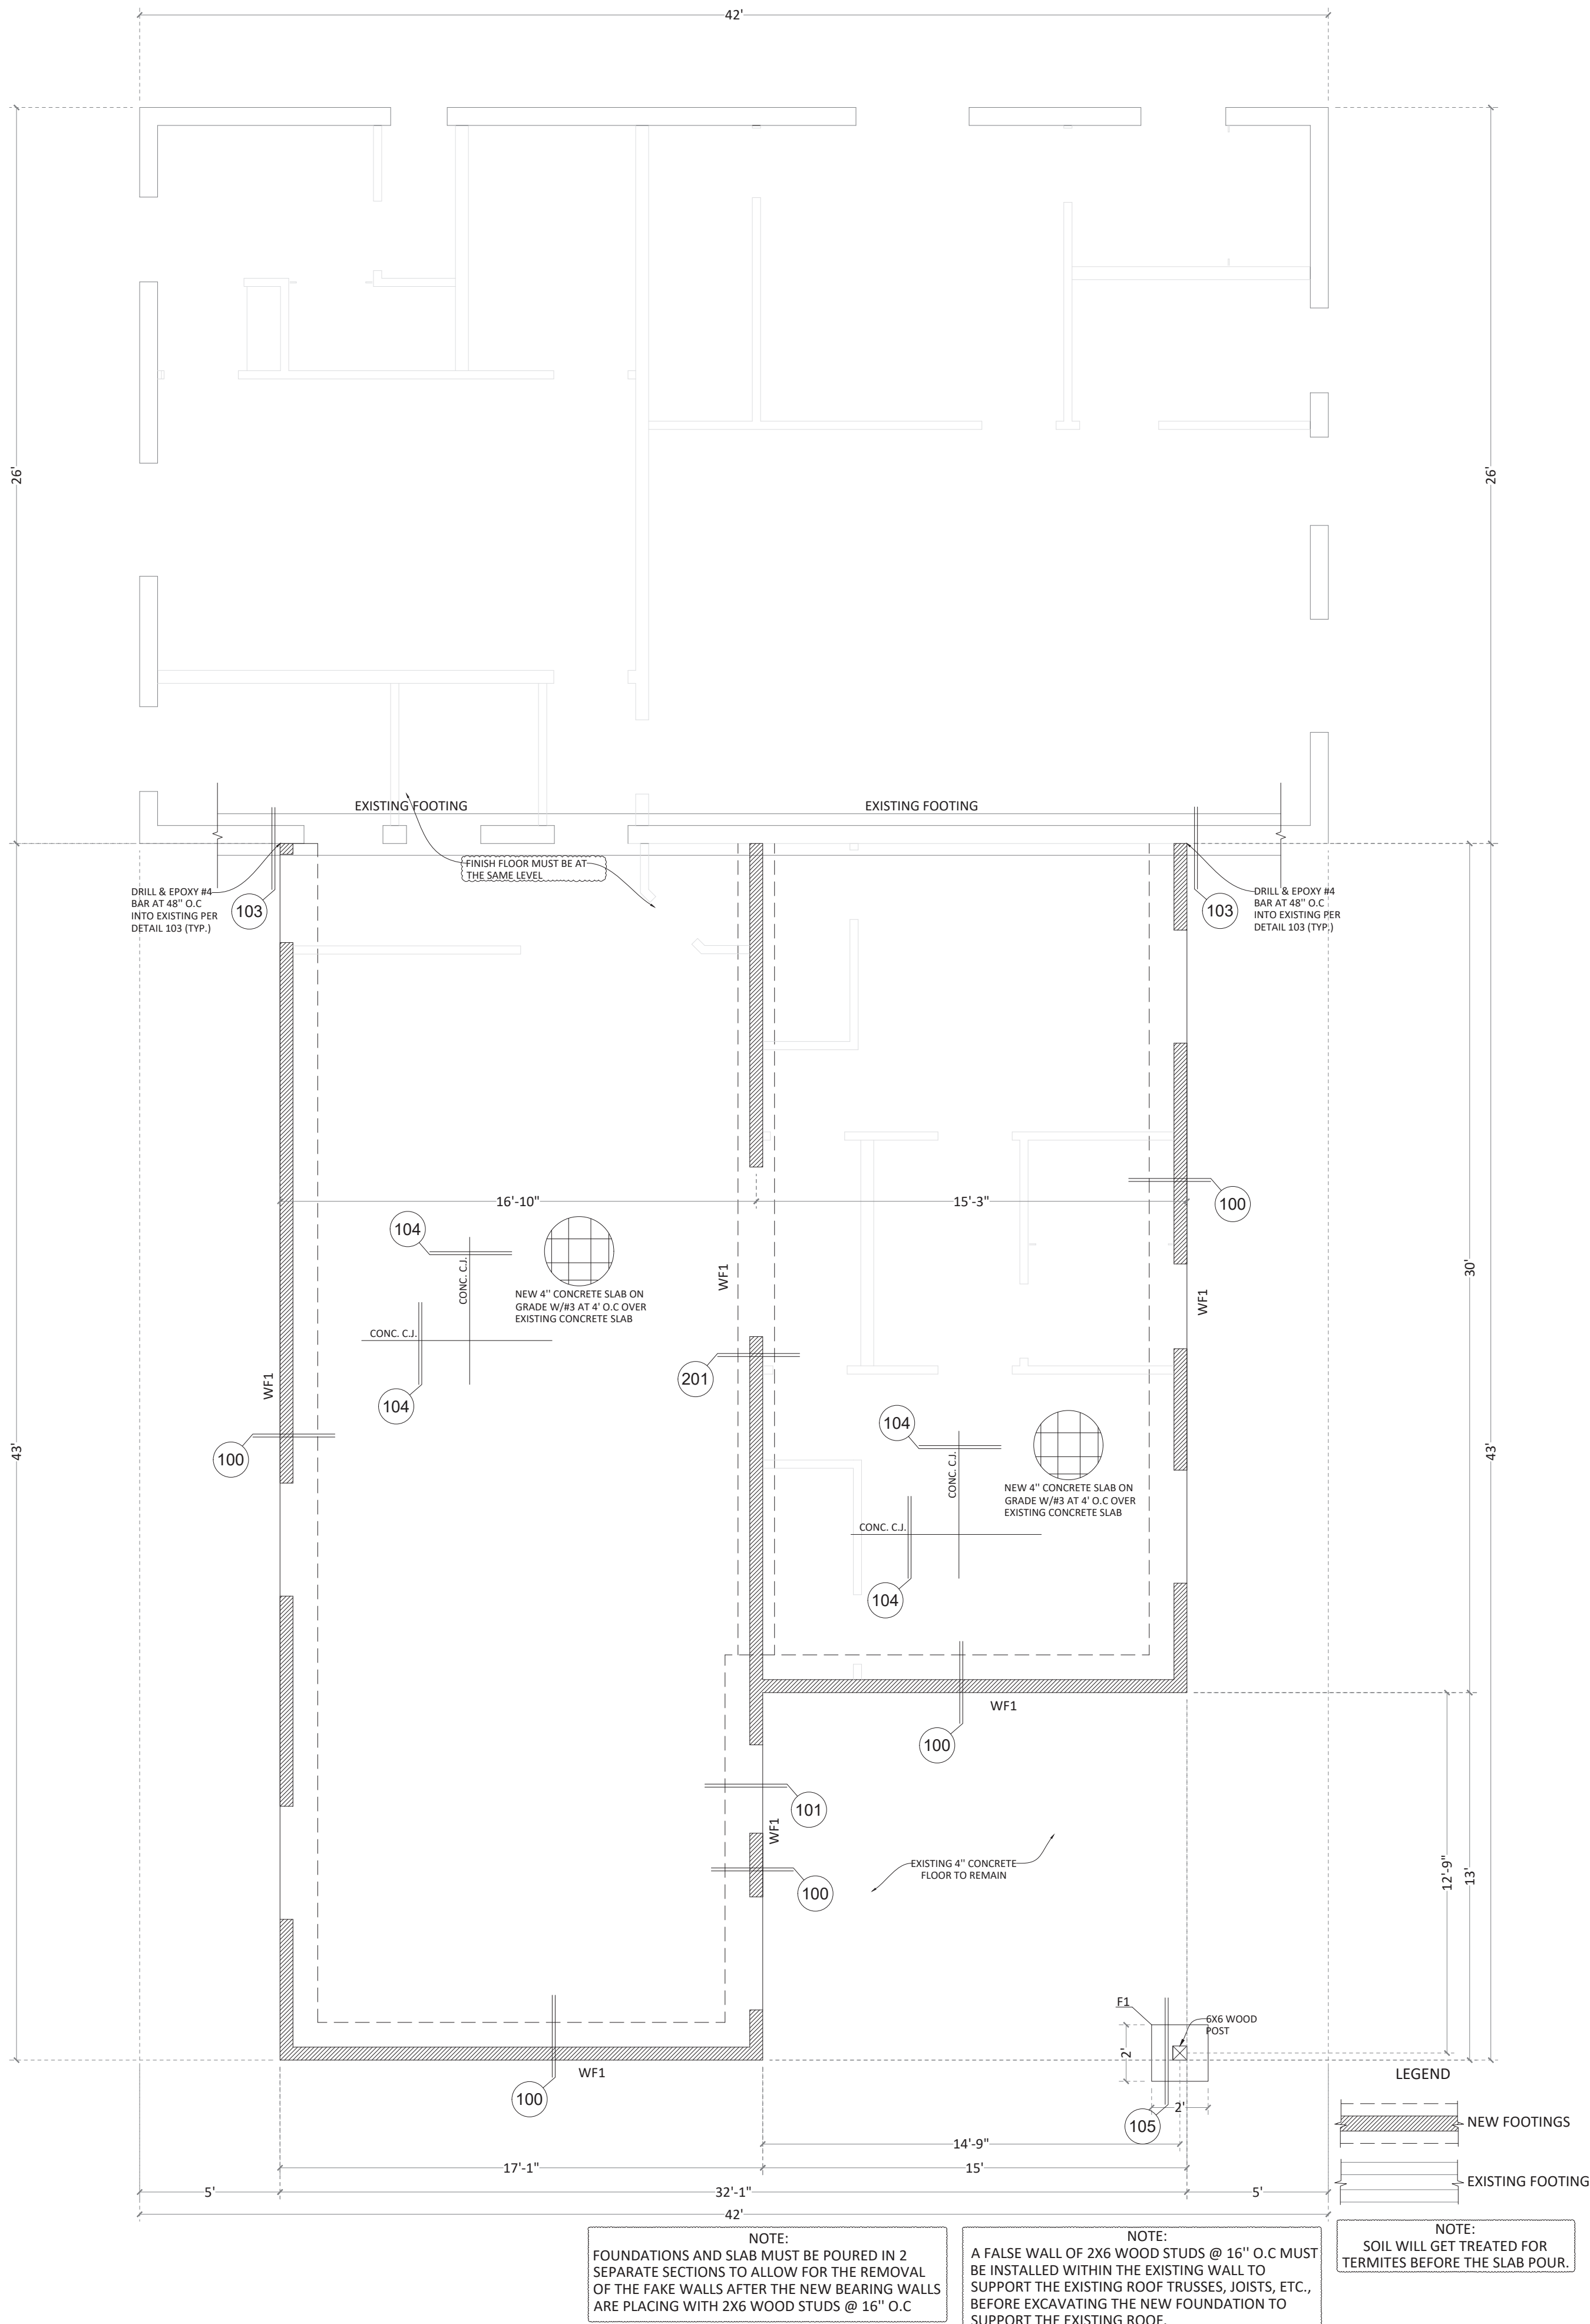


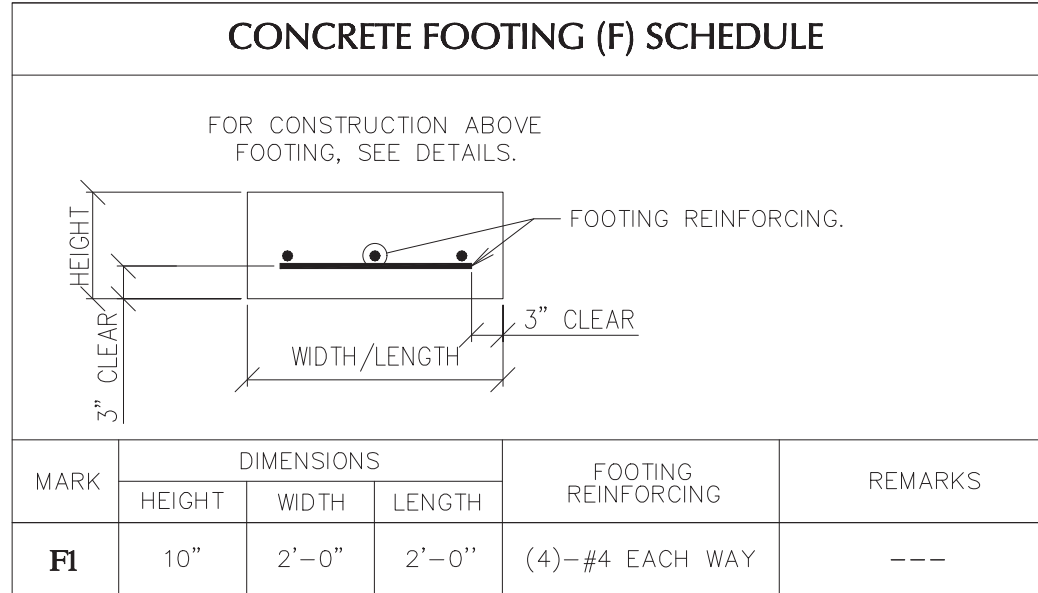


DOWEL SCHEDULE		
SLAB DEPTH "I"	DOWEL SIZE	
	ROUND	DIAMOND SHAPED
4" OR THINNER	1/2"x14" @ 18"O.C.	1/4"x4 1/2"x4 1/2" @ 22"O.C.

NOTE:

- CONSTRUCTION JOINTS NEED ONLY OCCUR AT EXPOSED EDGES DURING PLACEMENT UNLESS SPECIFICALLY NOTED ON THE PLANS.
- SLAB'S REINFORCEMENT TO BE LOCATED AT THE TOP 1/3 OF SLAB THICKNESS WHERE VAPOR BARRIER SPECIFIED ON PLANS.

NOTES

1. SAWN CUT SLAB ON GRADE.
2. SAWN CUT 1/8" WIDE X 1/4" SLAB THICKNESS IN DEPTH - CUT SHALL BE MADE SOON ENOUGH TO PREVENT SHRINKAGE CRACKING, BUT NOT SO SOON AS TO CAUSE SPALLING OF THE CONCRETE WHILE SAWING.
3. SAWING SHALL BE COMPLETED WITHIN 24 HOURS OF CONCRETE PLACEMENT.
4. CONSTRUCTION JOINT, CUT EVERY OTHER BAR.
5. DOWELS PER SCHEDULE.
6. DOWELS MUST BE CAREFULLY ALIGNED AND SUPPORTED DURING CONCRETE OPERATION.
7. MISALIGNED DOWELS CAUSE CRACKING.
8. STOP SLAB REIN. 1 1/2" AWAY FROM JOINT.
9. VAPOR BARRIER WHERE SPECIFIED ON PLAN.

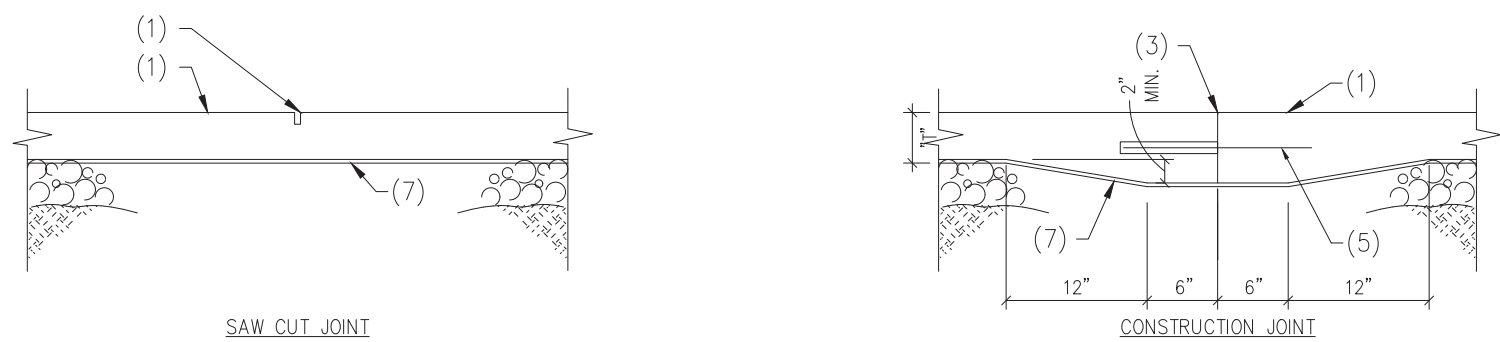

MESH - REINFORCED CONCRETE SLAB

